


PLANIT SAFE™ TEST SETUP FOR IN-LINE BALANCED PRESSURE LOW-FLOW (BLADDER TANK TYPE) PROPORTIONING

NOTES:

- 1.) THE QUANTITY OF TEST OUTLET VALVES WILL DEPEND ON REQUIRED FLOW RATE
- 2.) MULTIPLE FOAM PROPORTIONERS CAN BE TESTED SIMULTANEOUSLY
- 3.) SETUP APPLIES TO WET-PIPE AND PRE-ACTION TYPE SYSTEMS
- 4.) REFER TO GENERAL NOTES SHEET FOR ADDITIONAL INFORMATION

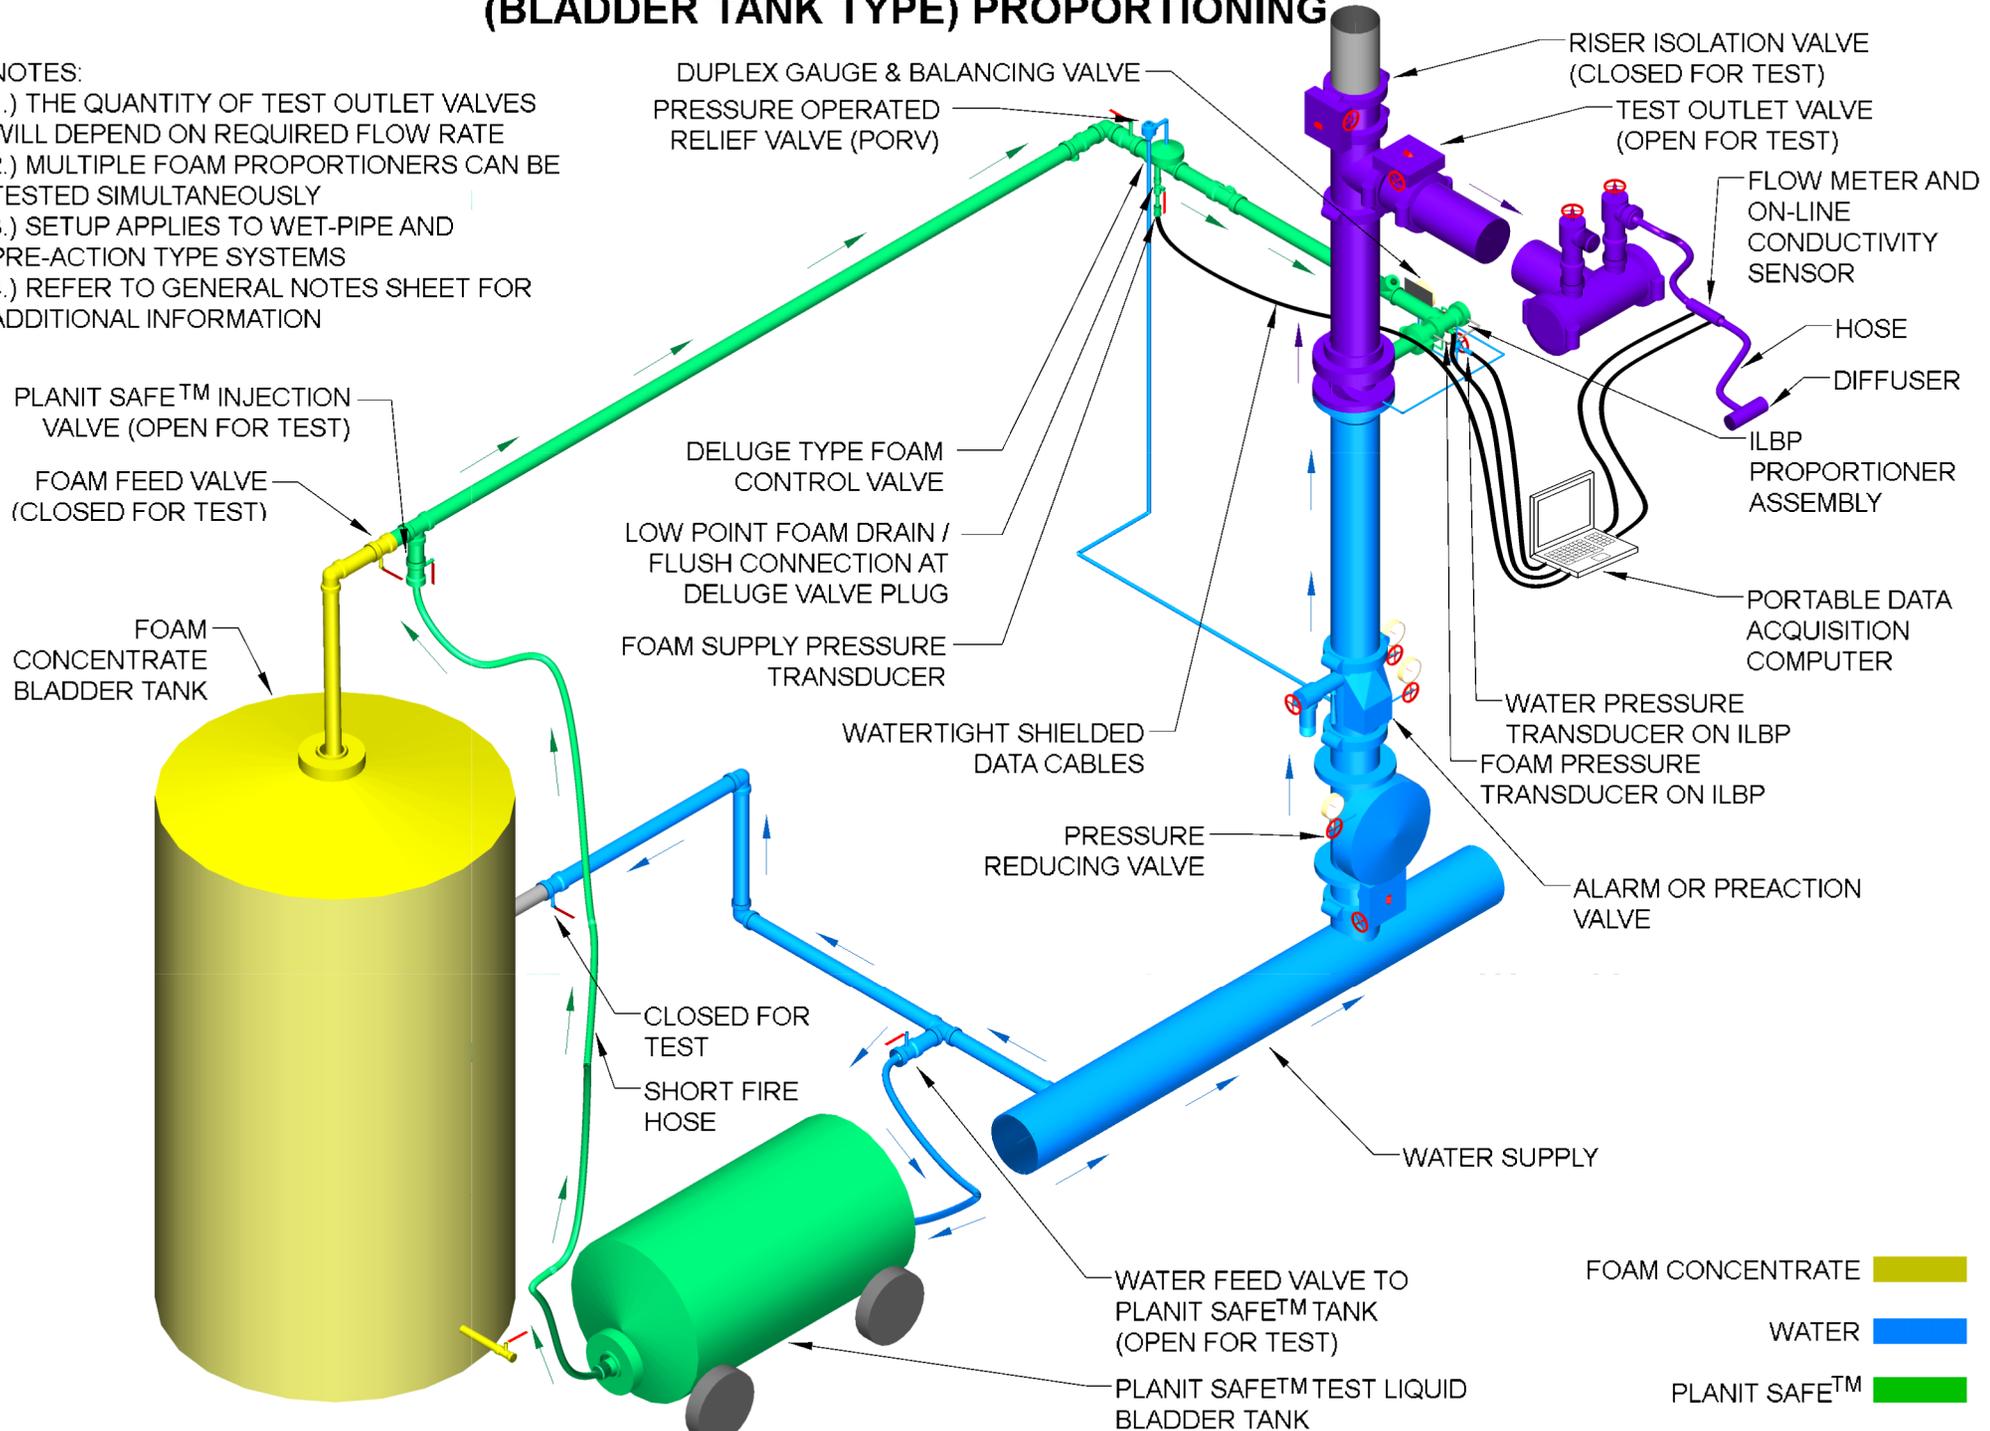

Drawing - VFTDW205 2018-06-22