


PLANT SAFETM™ TEST SETUP FOR BLADDER TANK/ HIGH-EXPANSION FOAM SYSTEM

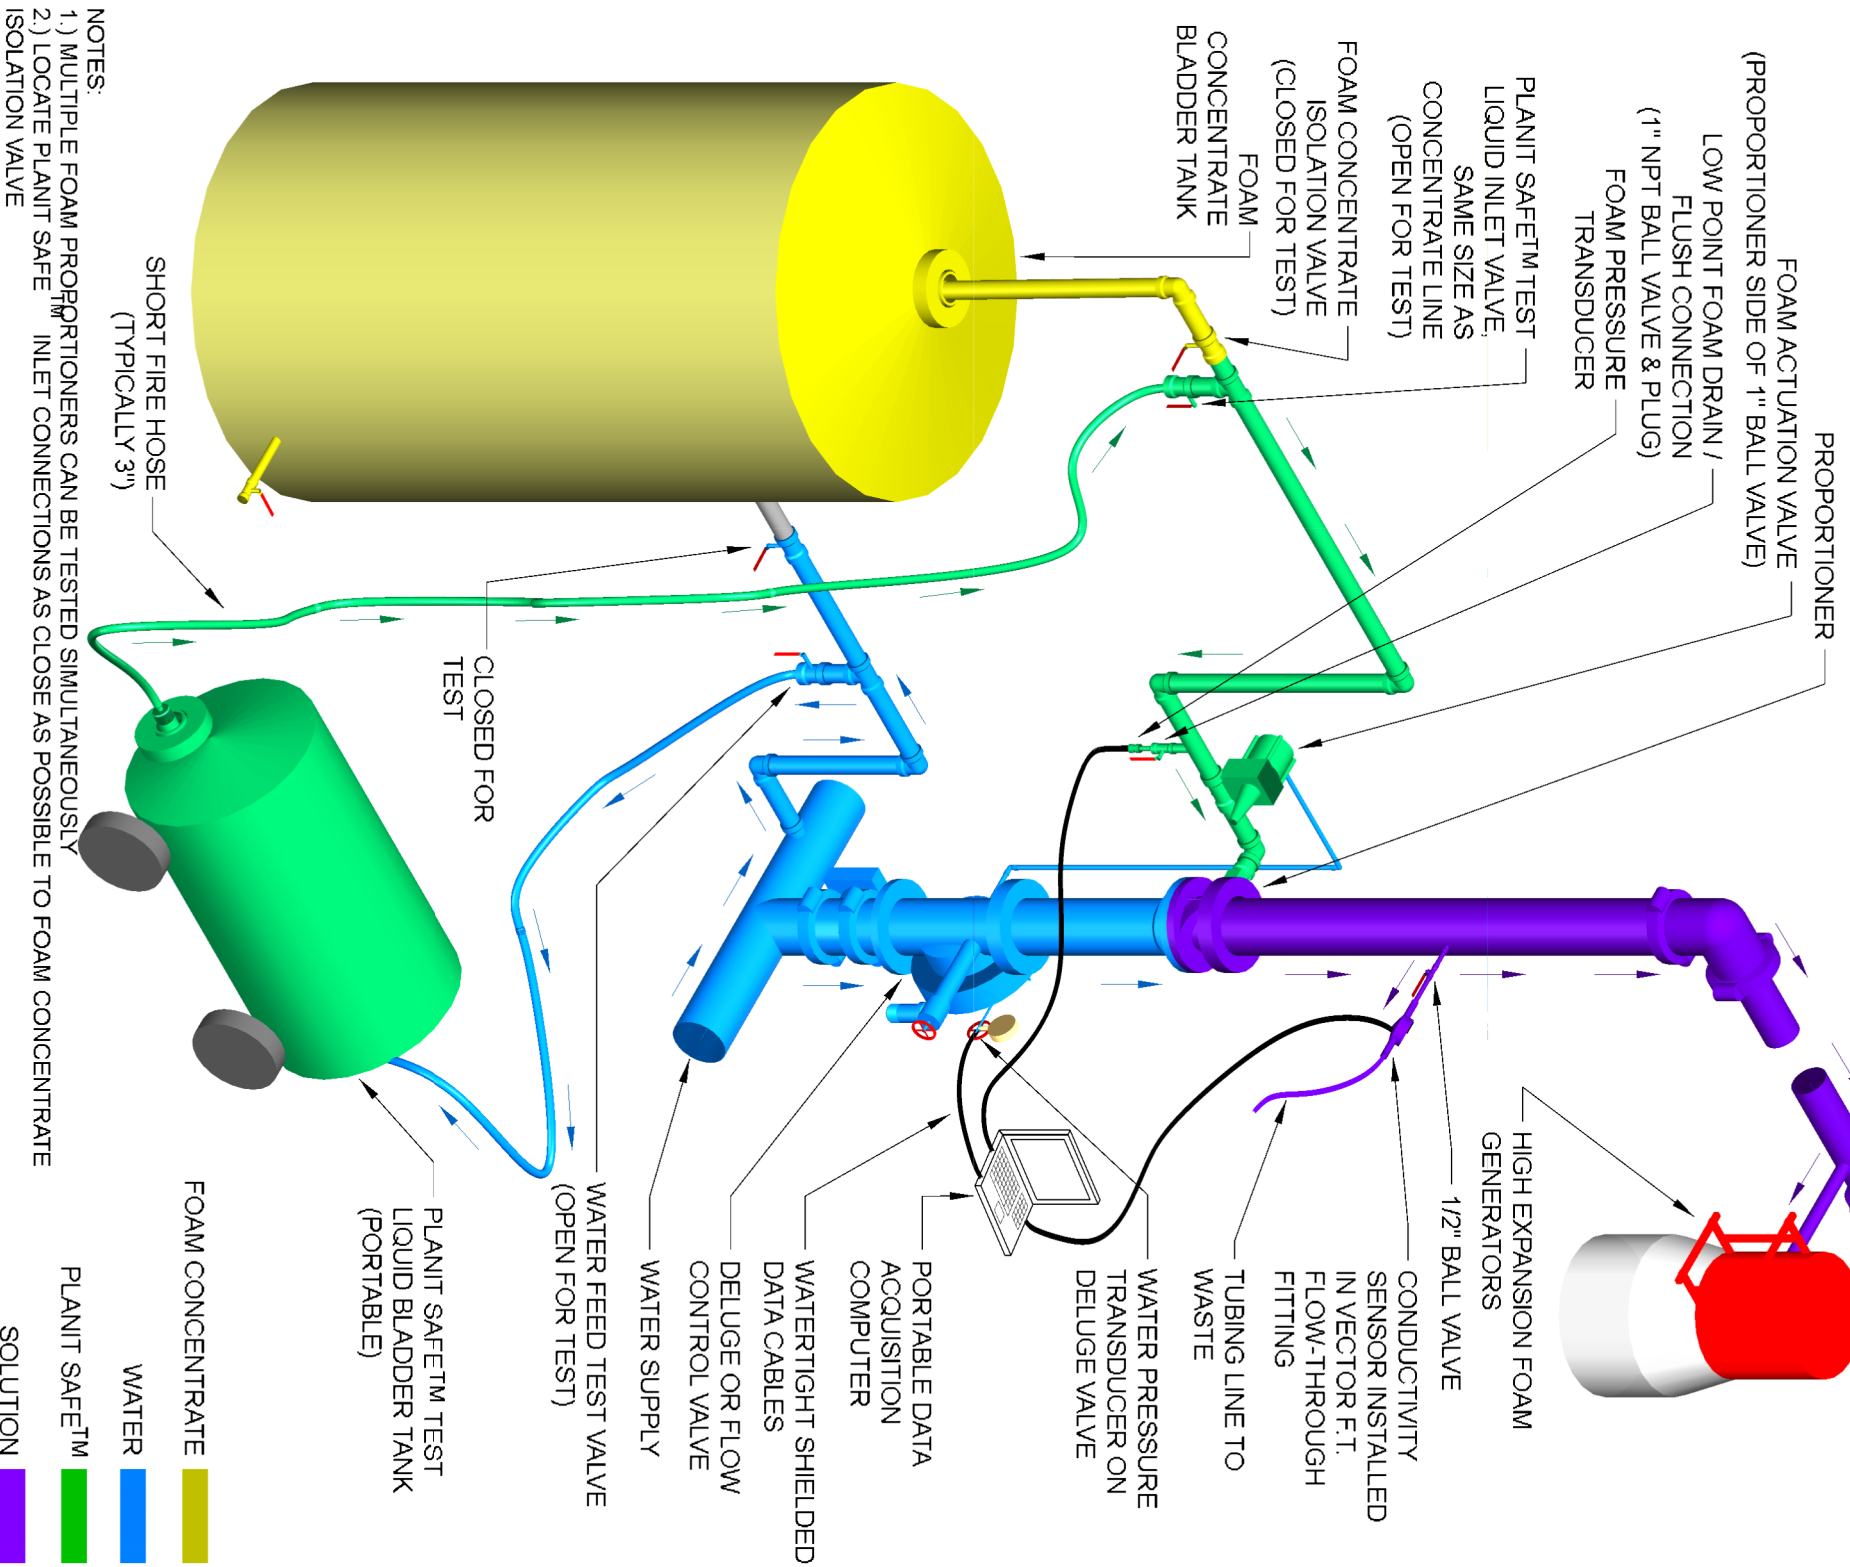

NOTES:

- 1.) MULTIPLE FOAM PROPORTIONERS CAN BE TESTED SIMULTANEOUSLY
- 2.) LOCATE PLANT SAFE™ INLET CONNECTIONS AS CLOSE AS POSSIBLE TO FOAM CONCENTRATE ISOLATION VALVE
- 3.) REFER TO GENERAL NOTES SHEET FOR ADDITIONAL INFORMATION