


PLANIT SAFE™ TEST SETUP FOR BLADDER TANK WITH VARIABLE RANGE PROPORTIONER FOR MULTIPLE RISERS

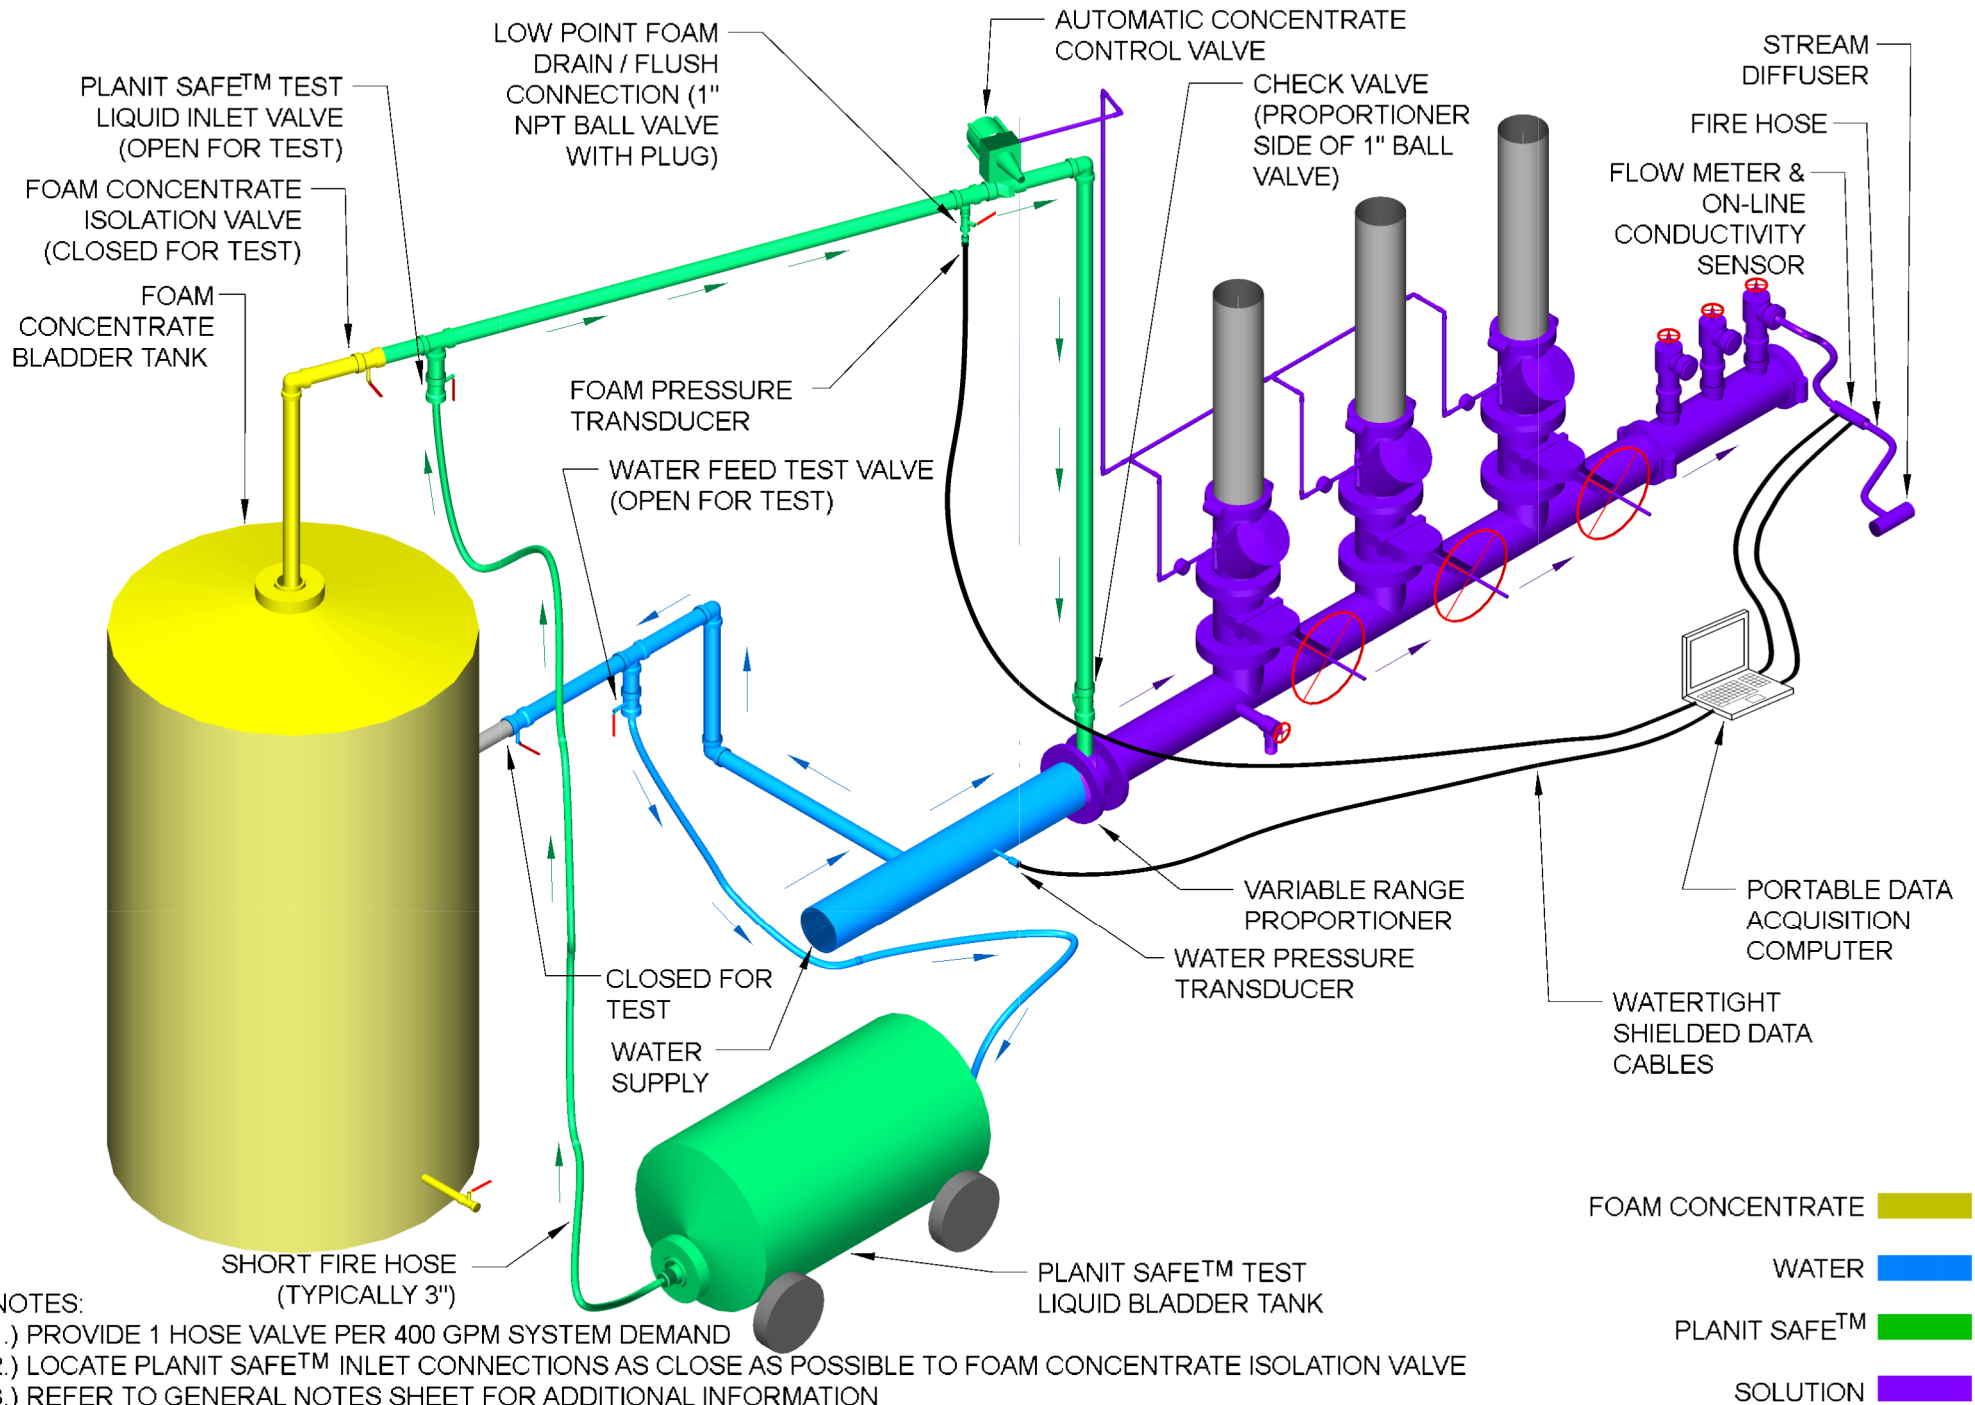

- NOTES:
- 1.) PROVIDE 1 HOSE VALVE PER 400 GPM SYSTEM DEMAND
 - 2.) LOCATE PLANIT SAFE™ INLET CONNECTIONS AS CLOSE AS POSSIBLE TO FOAM CONCENTRATE ISOLATION VALVE
 - 3.) REFER TO GENERAL NOTES SHEET FOR ADDITIONAL INFORMATION