


# PLANIT SAFE™ TEST SETUP FOR BLADDER TANK/ FOAM CHAMBER SYSTEM

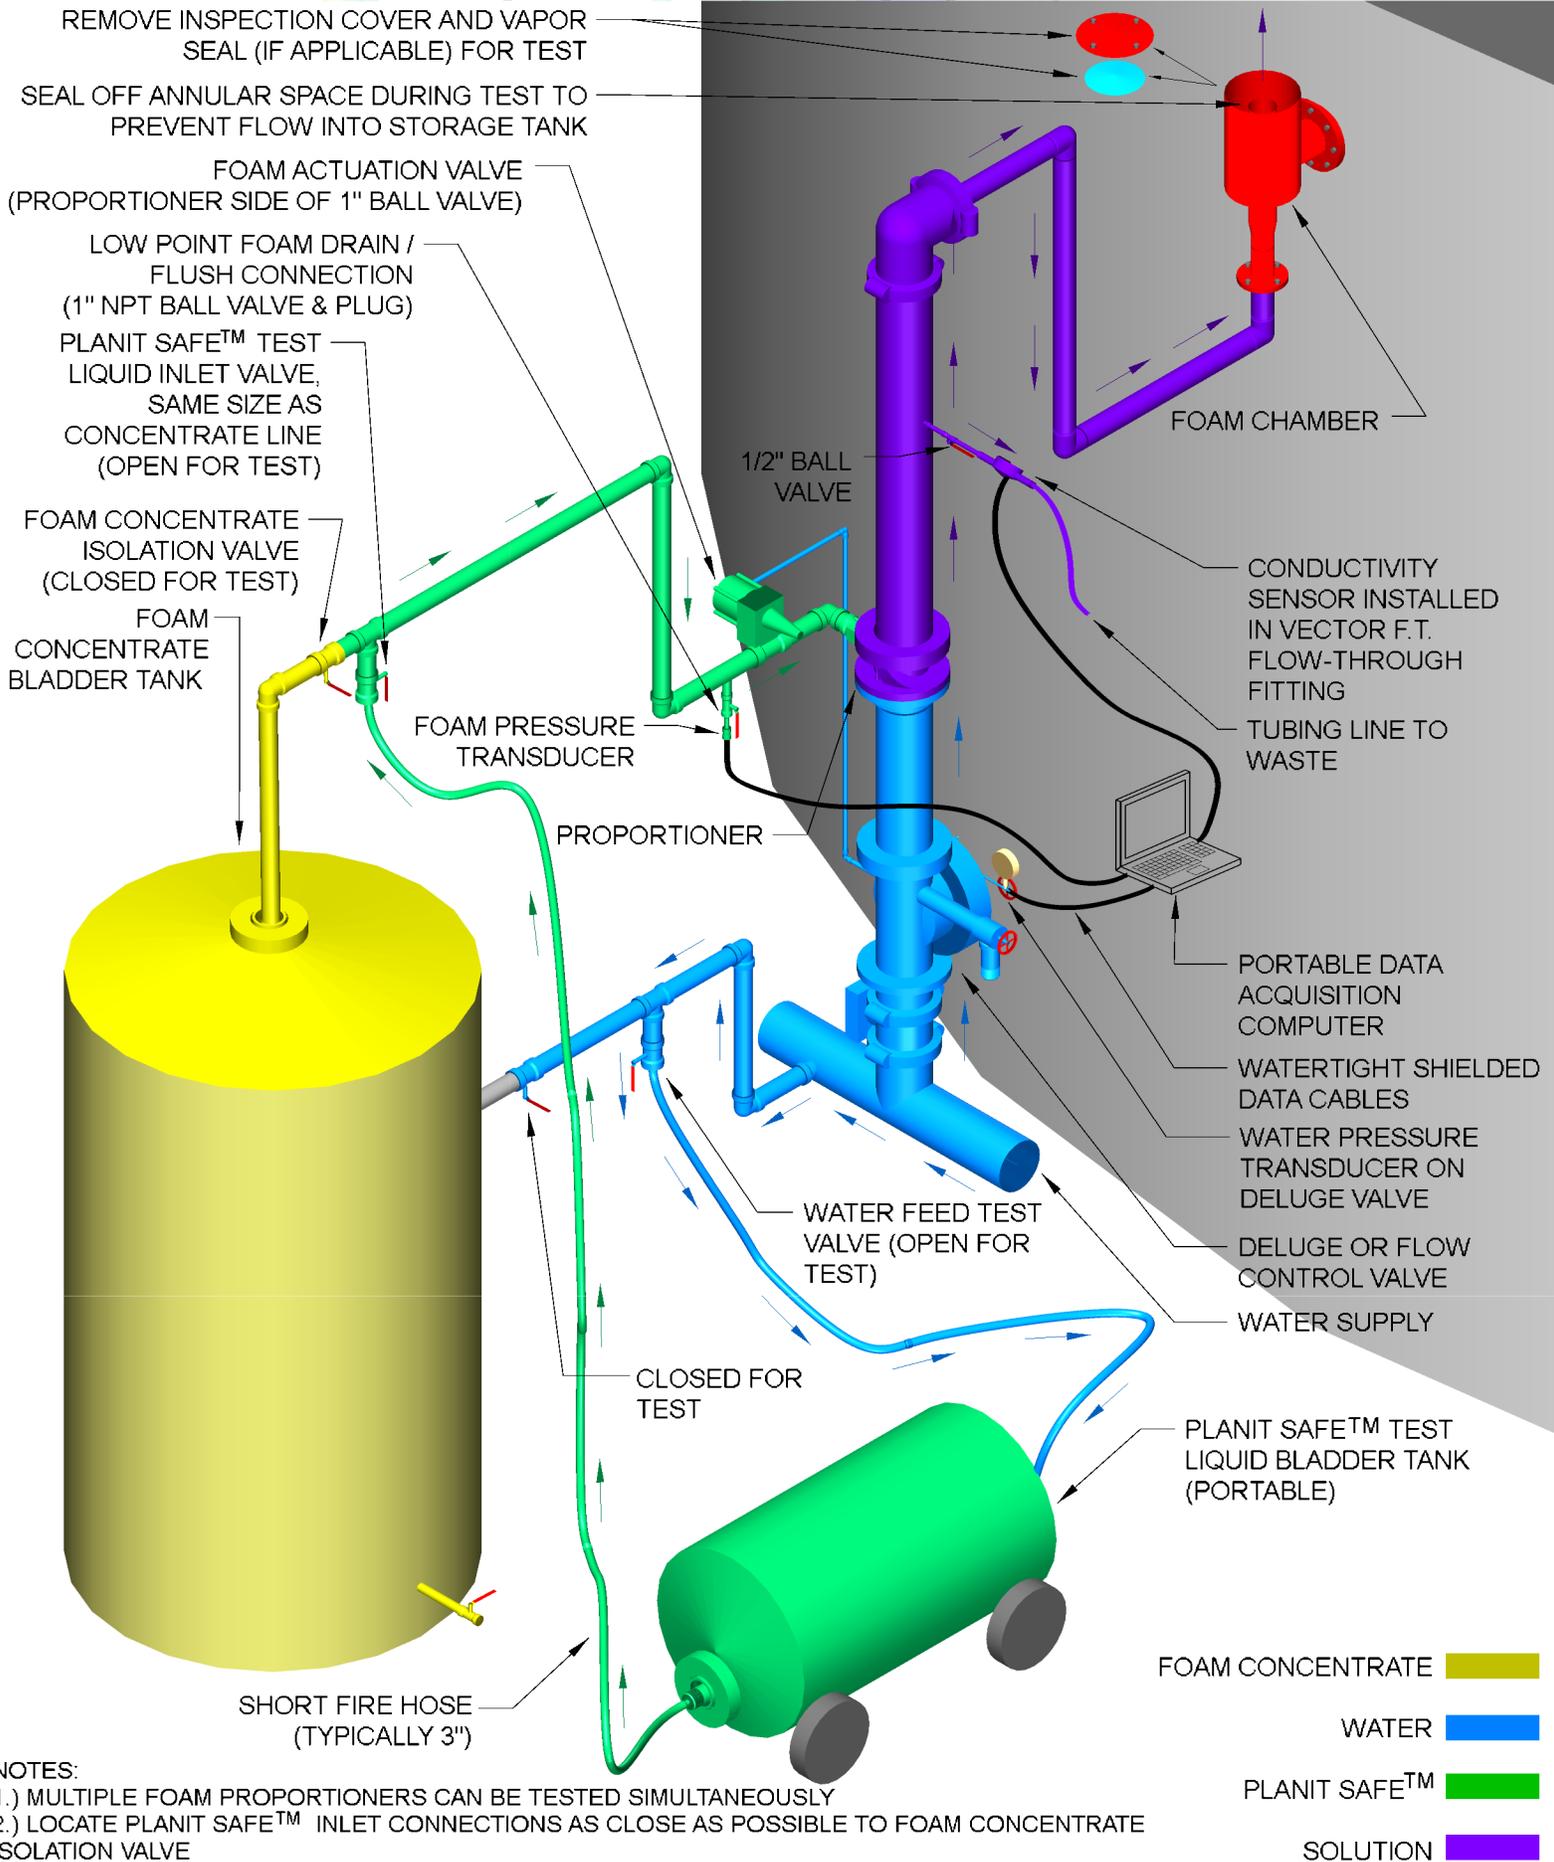

- NOTES:
- 1.) MULTIPLE FOAM PROPORTIONERS CAN BE TESTED SIMULTANEOUSLY
  - 2.) LOCATE PLANIT SAFE™ INLET CONNECTIONS AS CLOSE AS POSSIBLE TO FOAM CONCENTRATE ISOLATION VALVE
  - 3.) REFER TO GENERAL NOTES SHEET FOR ADDITIONAL INFORMATION

Drawing - VFTDW218 2019-04-01